


EXPANSION JOINT

ACCEPTABLE SYSTEMS: **NV 1.5" & NV 2" STANDING SEAM**

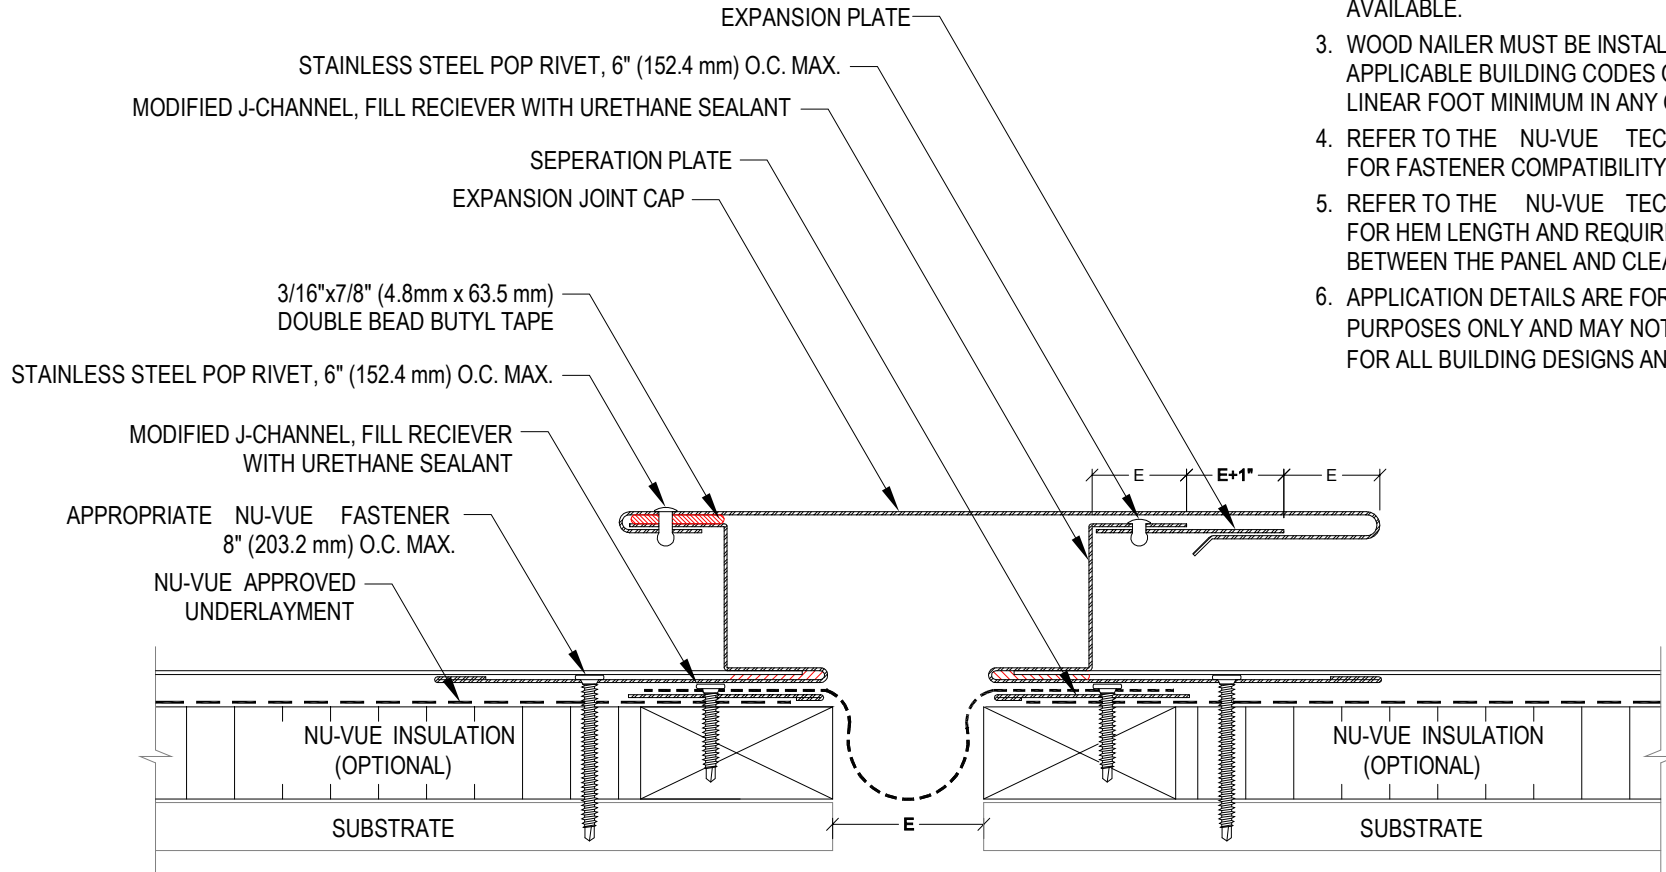

NOTES:

1. REFER TO NU-VUE WEBSITE FOR MOST CURRENT INFORMATION.
2. REFER TO TECHNICAL INFORMATION SHEETS FOR FASCIA SIZES, ACCESSORIES, AND FINISHES AVAILABLE.
3. WOOD NAILER MUST BE INSTALLED TO MEET APPLICABLE BUILDING CODES OR 200 LBS PER LINEAR FOOT MINIMUM IN ANY GIVEN DIRECTION.
4. REFER TO THE NU-VUE TECHNICAL DATABASE FOR FASTENER COMPATIBILITY WITH METAL.
5. REFER TO THE NU-VUE TECHNICAL DATABASE FOR HEM LENGTH AND REQUIRED DISTANCE BETWEEN THE PANEL AND CLEAT.
6. APPLICATION DETAILS ARE FOR ILLUSTRATION PURPOSES ONLY AND MAY NOT BE APPROPRIATE FOR ALL BUILDING DESIGNS AND CONDITIONS.

E = CALCULATED THERMAL OR STRUCTURAL MOVEMENT



www.nuvuepr.com

| | |
|-------------|--------|
| Job Name: | |
| Date: | |
| Contractor: | Notes: |